DEMOLITION NOTES THIS SHEET

1. REMOVE VARIABLE AIR VOLUME BOX AND ASSOCIATED CONTROL WIRING AND STORE FOR RELOCATION UON. SEE NEW WORK DRAWINGS. TEMPORARILY CAP CONTROL AIR SOURCE.
2. REMOVE DUCTWORK, INSULATION, HANGERS, AND SUPPORTS COMPLETE TO POINT INDICATED. PROVIDE TEMPORARY AIR TIGHT CAPS WHERE ETR DUCT WILL BE RECONNECTED.
3. REMOVE CEILING MOUNTED UNIT HEATER, HANGERS, AND SUPPORTS.
4. REMOVE 5 TON RTU AND ASSOCIATED DUCTWORK COMPLETE. EVACUATE REFRIGERANT. PROVIDE CURBS AND INSULATED CROSS BROKEN CAPS AT ROOF PENETRATIONS.
5. REMOVE DIFFUSERS AND GRILLES TO POINT OF DEMOLITION LIMIT. REFER TO NEW WORK DRAWING M1.3W FOR AIRFLOWS.

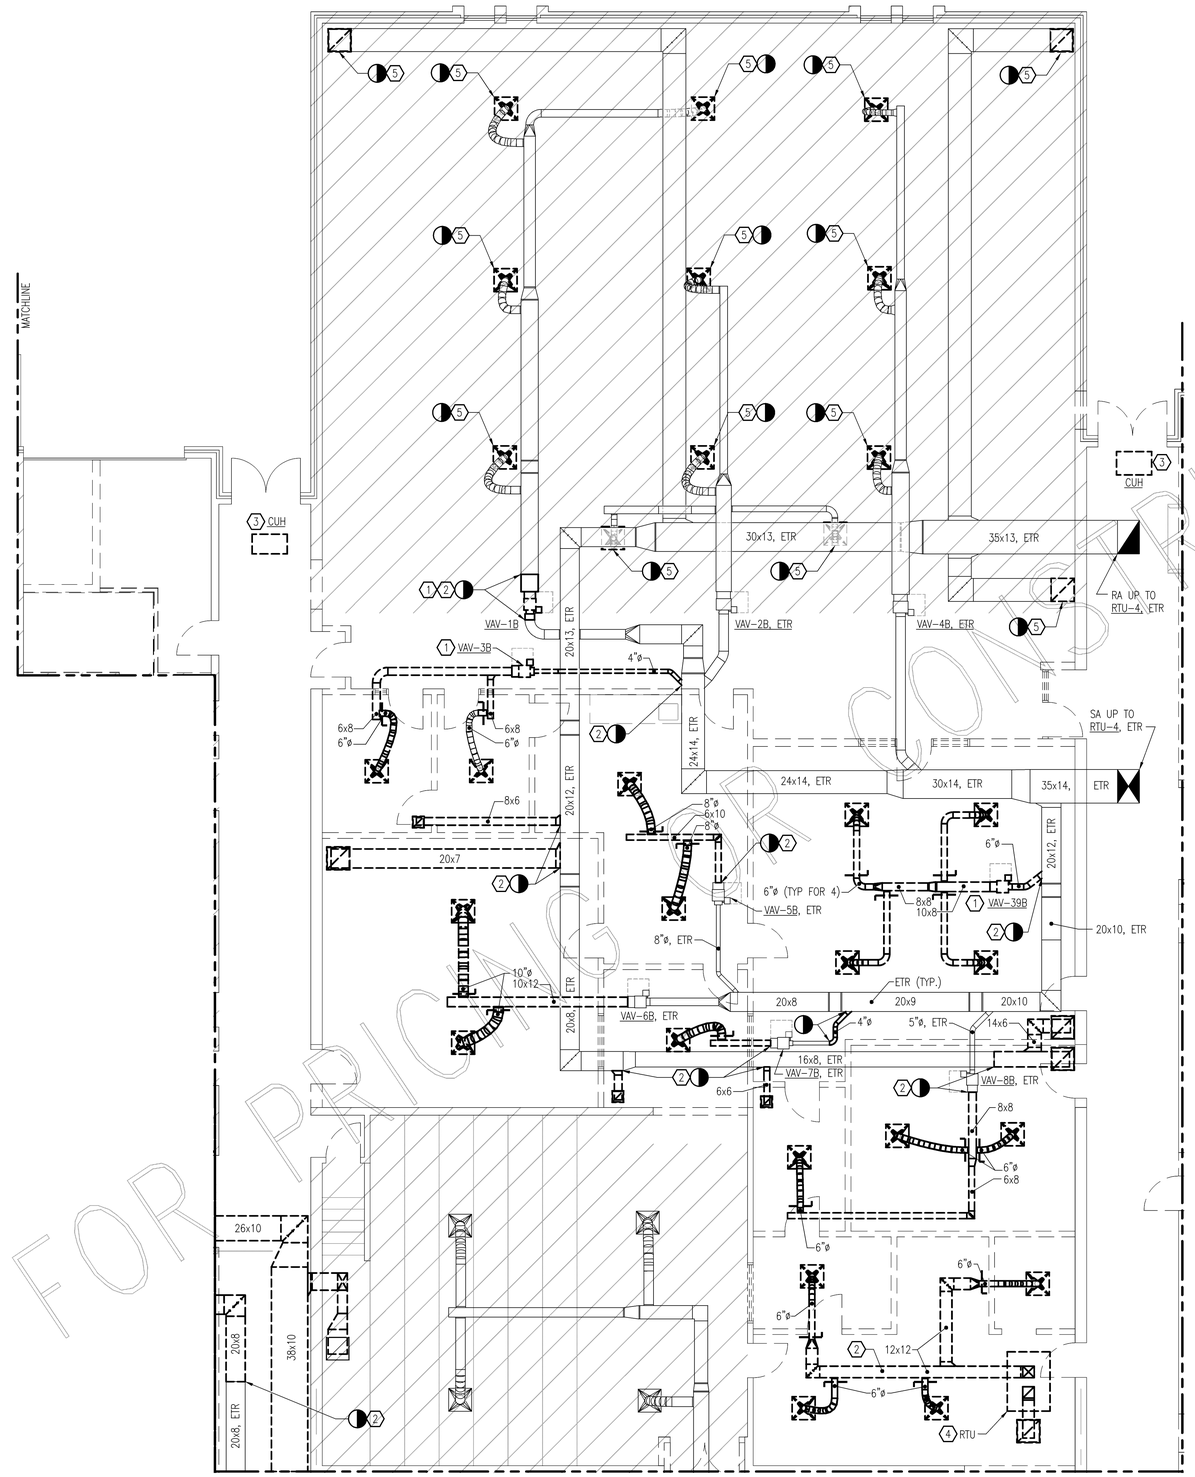

DEMOLITION FLOOR PLAN – MECHANICAL DUCTWORK
SCALE: 3/16" = 1'-0"

REFRIGERANT RECOVERY NOTE

REFRIGERANT FROM EXISTING MECHANICAL SYSTEMS SHALL BE RECOVERED AND RECYCLED FOR RECLAIM. EQUIPMENT CAPABLE OF PULLING A VACUUM OF LESS THAN 1000 MICRONS OF MERCURY SHALL BE USED TO RECOVER REFRIGERANT. MECHANICAL SYSTEMS SHALL NOT BE OPENED TO ATMOSPHERE FOR DEMOLITION UNTIL ALL REFRIGERANT IS FULLY RECOVERED. THE CONTRACTOR SHALL PROVIDE CONTAINERS FOR THE STORAGE OF THE REFRIGERANT. TURN REFRIGERANT OVER TO THE COTR AFTER RECOVERY AND DELIVER TO A STORAGE SITE AS IDENTIFIED BY COTR.

ASBESTOS AND LEAD PAINT NOTE

AN ASBESTOS INSPECTION WAS PERFORMED AND ASBESTOS CONTAINING MATERIALS WERE FOUND GENERALLY IN THE AREAS INDICATED IN THE ASBESTOS SURVEY/INSPECTION REPORT WHICH IS AVAILABLE TO THE CONTRACTOR(S) FOR HIS INFORMATION. ASBESTOS CONTAINING MATERIALS HAVE BEEN REMOVED UNDER A SEPARATE CONTRACT.

A LEAD-BASED PAINT INSPECTION WAS PERFORMED AND LEAD-BASED PAINT WAS FOUND IN THE AREAS INDICATED. THE CONTRACTOR SHALL BE RESPONSIBLE WITH ALL REQUIREMENTS OF THE VIRGINIA OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION REGULATIONS LEAD-BASED PAINT PROTECTION OF WORKERS.



KEYPLAN
NO SCALE

GRAPHIC SCALES
3/16" = 1'-0" 0' 5' 10' 20'

NOT FOR PRICING OR CONSTRUCTION

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
℡ (804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK
COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS DEMOLITION FLOOR
PLAN - MECHANICAL DUCTWORK

Date:
JANUARY 13, 2010

REVISIONS

NO.	DATE

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
01-13-10
PROFESSIONAL ENGINEER

Sheet
MD1.3W

File Number
XX